

1

2

3

4

5

6

A

B

C



D

A

B

C

D

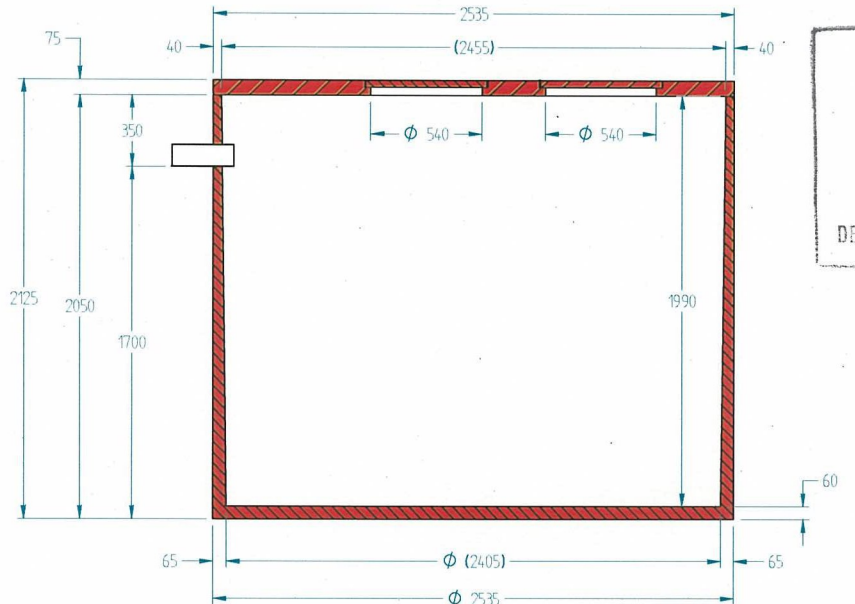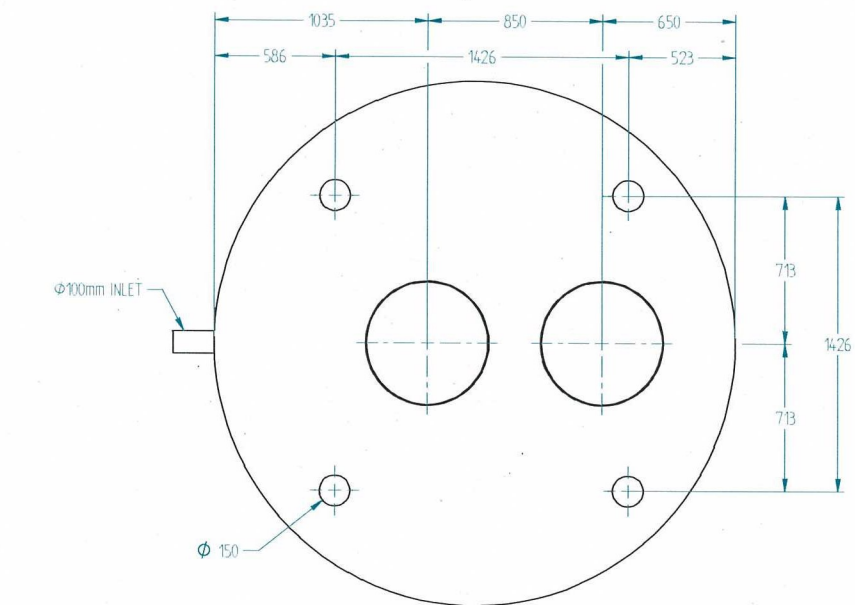

APPROVED

1 8 AUG 2010

DEPARTMENT OF HEALTH, N.S.W.

- NOTES:**
1. SEPTIC TANKS TO BE MANUFACTURED AND TESTED IN ACCORDANCE WITH AS/NZS 1546.12008
 2. CONCRETE STRENGTH = 40MPa
 3. CONCRETE TO BE VIBRATED TO ENSURE WELL COMPACTED CONCRETE
 4. TANKS TO BE REINFORCED WITH FIBRE STEEL
 5. LIFTING TO BE "REID SWIFT LIFTS" 4 x 2.5 TONNE FOOT ANCHORS CAST INTO BASE OF THE TANK, 3 x 1.3 TONNE ANCHORS CAST INTO TANK LIDS

Econocycle ABATED WASTEWATER TREATMENT SYSTEMS	DO NOT SCALE	DATE PLOTTED 27/07/2010	PROJECT COLLECTION WELL
	SCALE	UNLESS OTHERWISE SPECIFIED ALL DIMENSIONS ARE IN MM	TITLE 7300L CONCRETE TANK ASSY NSW HEALTH CERTIFICATION DRAWING
COPYRIGHT THIS DRAWING AND ANY PARTS OR DETAILS THEREOF ARE THE PROPERTY OF ECONOCYCLE AND SHALL BE KEPT IN CONFIDENCE AND NOT REPRODUCED WITHOUT WRITTEN PERMISSION	DRAWN BY P. MCKAY	DRAWING LAST MODIFIED BY P. MCKAY	SHEET SIZE A3
	MODELLED BY P. MCKAY	MODEL LAST MODIFIED BY P. MCKAY	PART# 124_1110
		REVISION 1.B	SHEET No 1 OF 1

1

2

3

4

5

6